


Designated Parking Lots

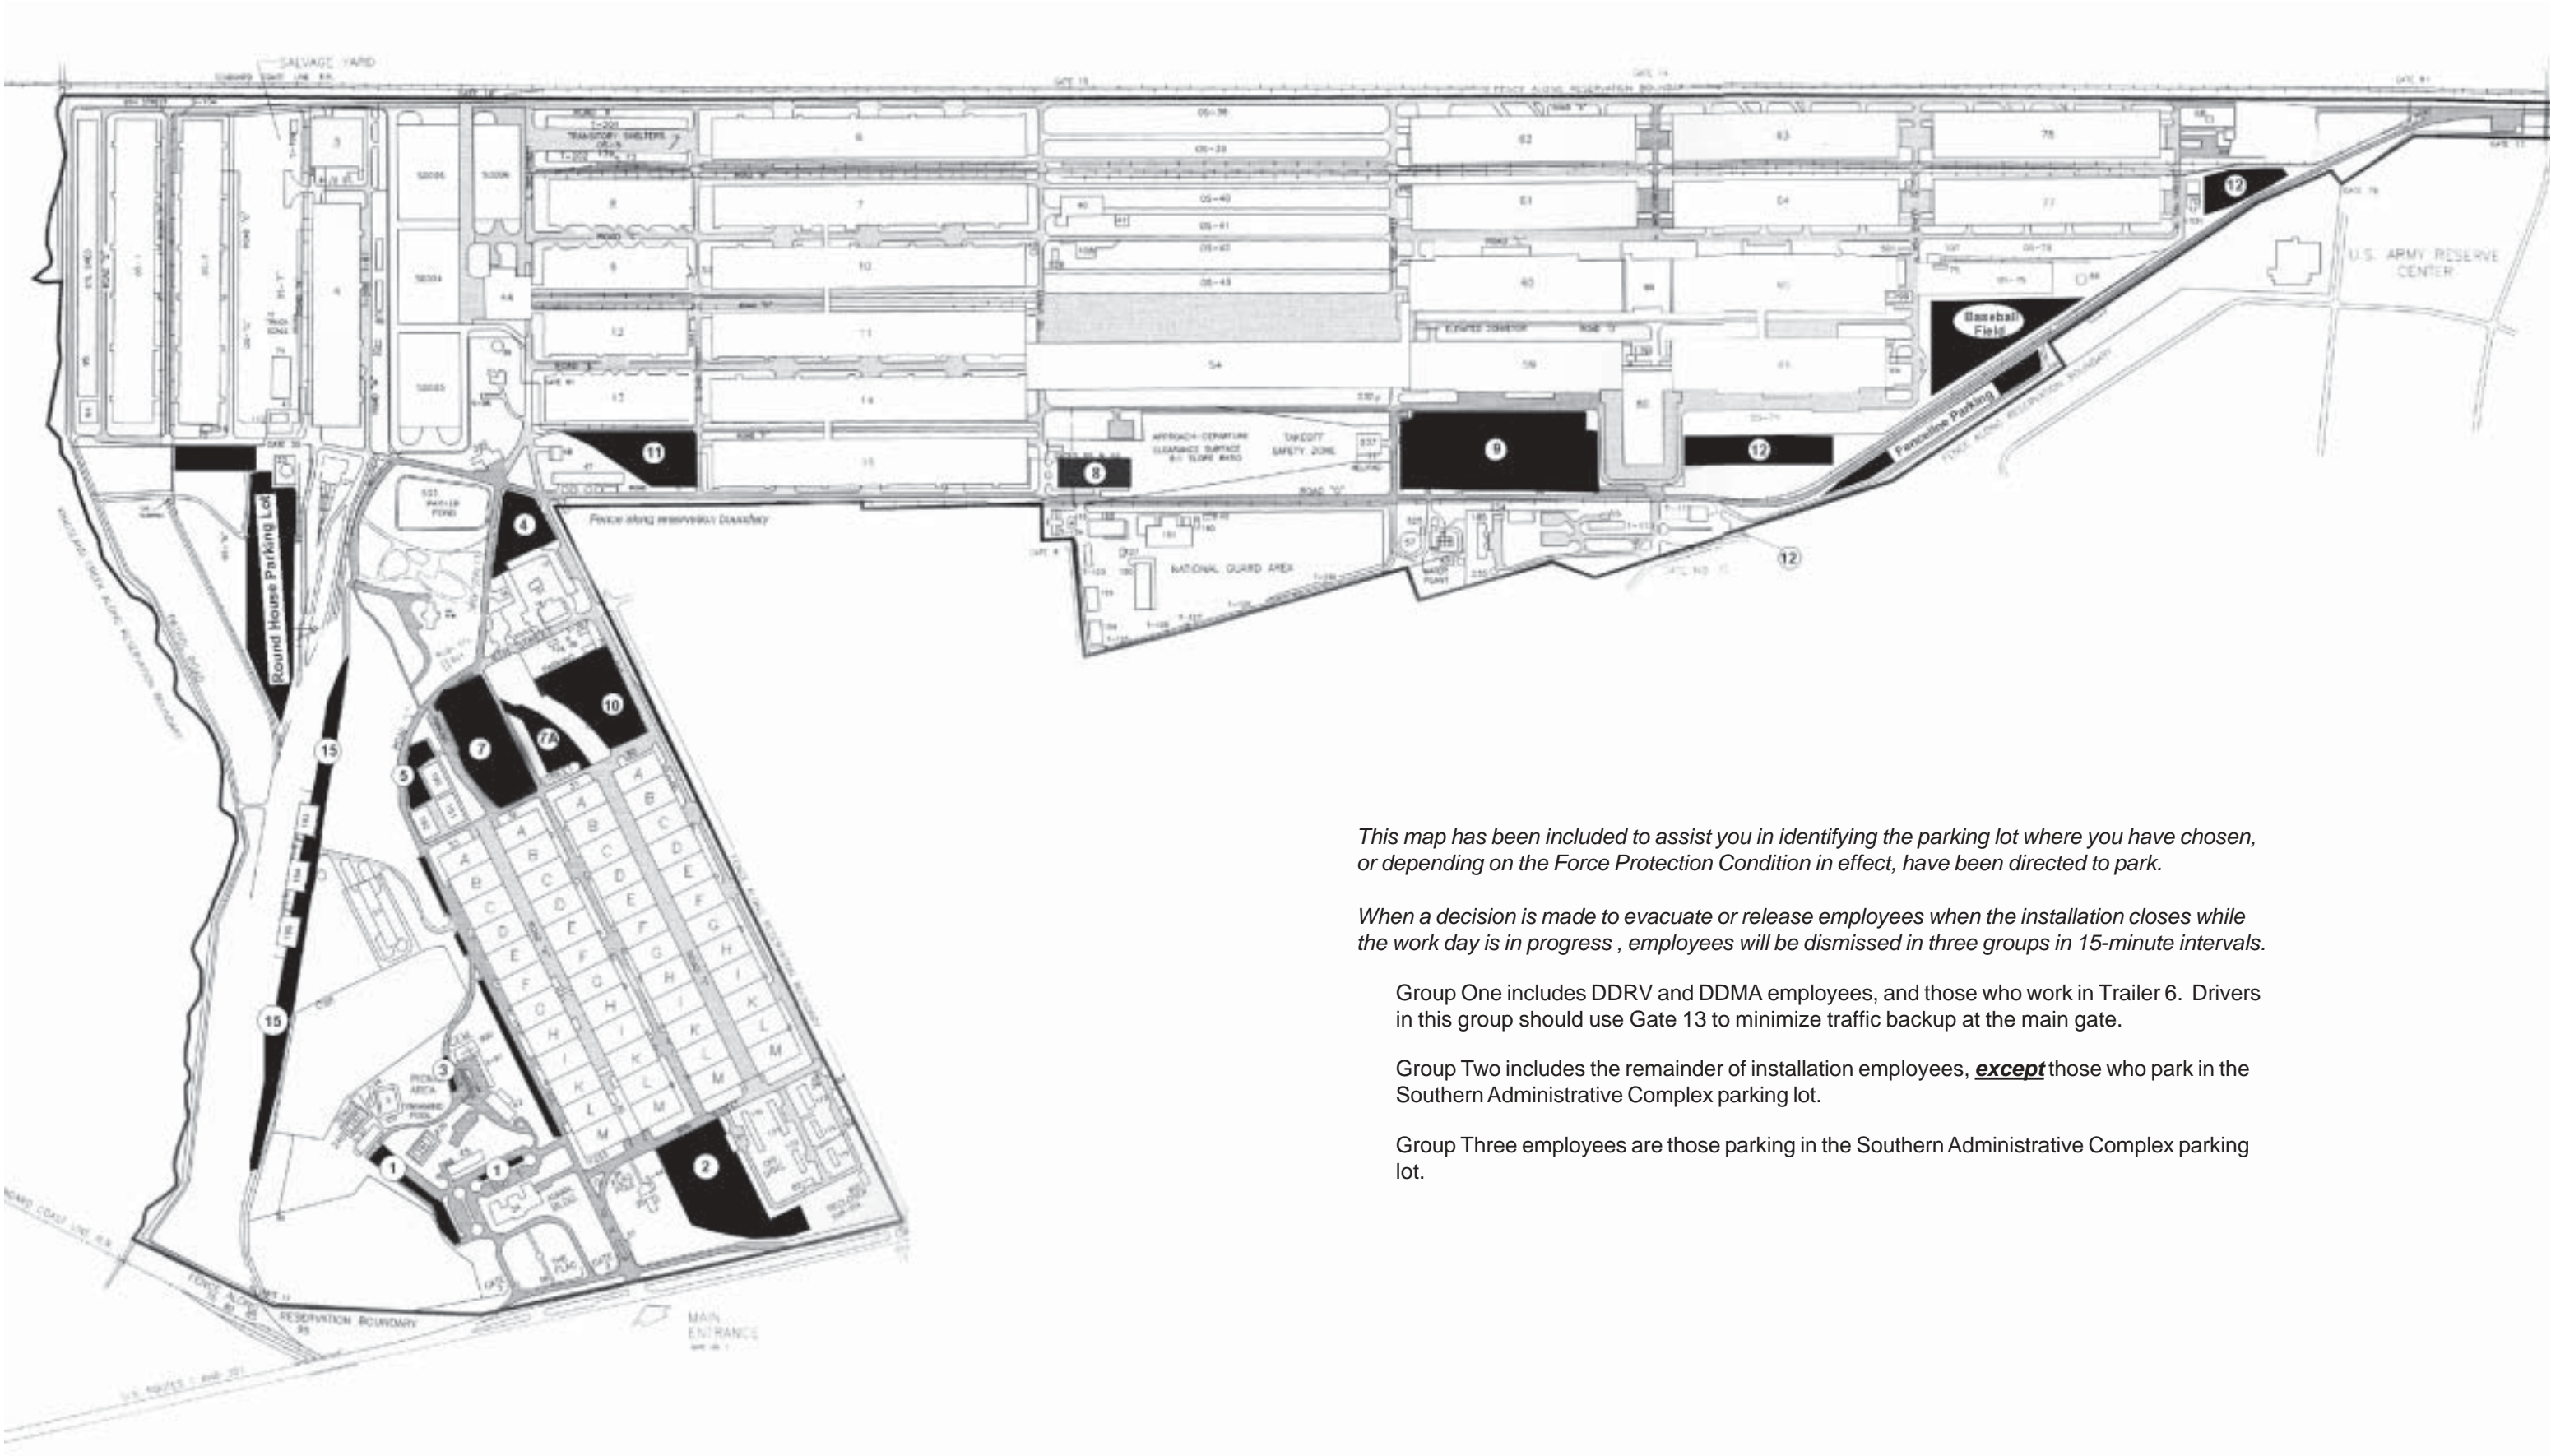

This map has been included to assist you in identifying the parking lot where you have chosen, or depending on the Force Protection Condition in effect, have been directed to park.

When a decision is made to evacuate or release employees when the installation closes while the work day is in progress , employees will be dismissed in three groups in 15-minute intervals.

Group One includes DDRV and DDMA employees, and those who work in Trailer 6. Drivers in this group should use Gate 13 to minimize traffic backup at the main gate.

Group Two includes the remainder of installation employees, except those who park in the Southern Administrative Complex parking lot.

Group Three employees are those parking in the Southern Administrative Complex parking lot.